

Esmi Impresia Red VAD Wall Mounted Sounder

Instruction Sheet R10228GB0



Schneider Electric Fire & Security Oy

Sokerilinnantie 11 C FI-02600 Espoo, Finland Tel: +358 10 446 511 Website: www.se.com Document number: R10228GB0 Published: 18.12.2020

© 2020 – Schneider Electric. All Rights Reserved. This information is only to be used as guidance. Subject to changes and errors.




1

Esmi Impresia Red VAD Wall Mounted Sounder

Esmi Impresia Red VAD Wall Mounted Sounder (FFS06741012) is an addressable wall mounted sounder and strobe with a built-in isolator, designed for installing in addressable fire alarm systems with Esmi ELC loop controller supporting Schneider Electric communication protocol. The sounder is compatible with fire bases Esmi Impresia Standard Base (FFS06741018) for ceiling or wall mounting and Esmi Impresia Red IP65 Deep Base (FFS06741013) for wall mounting. EN 54-3 approved and for indoor and outdoor use.

The address setting is done by the panel or handheld addressing device. The address range is 1-250.

Essential characteristics	Performance	
Performance under fire conditions	Pass	
Operational reliability	Pass	
Duration of operation	Pass	
Provision for external conductors	Pass	
Flammability of materials	Pass	
Endosure protection	Pass	
Access	Pass	
Manufacturer's adjustments	Pass	
On-site adjustments of behavior	Pass	
Requirements for software controlled devices	Pass	
Coverage volume	Pass	
Variation of light output	Pass	
Min. and max. light intensity	Pass	
Light color	White	
Light temporal pattern/ frequency of flashing	Pass	
Marking and data	Pass	
Synchronization	Pass	
Durability:		
Temperature resistance	Pass	
Humidity resistance	Pass	
Shock and vibration resistance	Pass	
Corrosion resistance	Pass	
Resistance to ingress	Pass	
Electrical stability	Pass	

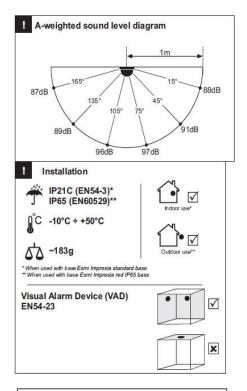



1.1 Supported tone types and description

Tone	Tone Type	Tone Description / Application
1		970Hz
2		800Hz/970Hz @ 2Hz
3	$\overline{\lambda}$	800Hz - 970Hz @ 1Hz
4	— — — —	970Hz 1s OFF/1s ON
5		970Hz, 0.5s/630Hz, 0.5s
6		554 Hz, 0.1s/ 440 Hz, 0.4s (AFNOR NF S 32 001)
7	\leq	500 - 1200Hz, 3.5s/ 0.5s OFF (NEN 2575:2000)
8	— — — —	420Hz 0.625s ON/0.625s OFF (Australia AS1670 Alert tone)
9	\land	500 - 1200Hz, 0.5s/ 0.5s OFF x 3/1.5s OFF (AS1670 Evacuation)
10		550Hz/440Hz @ 0.5Hz
11		970Hz, 0.5s ON/0.5s OFF x 3/1.5s OFF (ISO 8201)
12		2850Hz, 0.5s ON/0.5s OFF x 3/1.5s OFF (ISO 8201)
13	222	1200Hz - 500Hz @ 1Hz (DIN 33404)
14		400 Hz
15		550Hz, 0.7s/1000Hz, 0.33s
16	\leq	1500Hz - 2700Hz @ 3Hz
17		750Hz
18		2400Hz
19		680Hz
20	— — — —	660Hz 1.8s ON1.8s OFF
21		660 Hz 0.15s ON0.15s OFF
22		510Hz, 0.25s/610Hz, 0.25s
23		800/1000Hz 0.5s each (1Hz)
24	\searrow	250Hz - 1200Hz @ 12Hz
25	$\sim \sim$	500Hz - 1200Hz @ 0.33Hz
26	$\overline{\mathcal{M}}$	2400Hz - 2900Hz @ 9Hz
27*	$\overline{\mathcal{M}}$	2400Hz - 2900Hz (§ 3Hz 2500Hz (main sound frequency)
28	$\overline{\mathcal{M}}$	800Hz - 970Hz @ 100Hz
29	$\overline{\mathcal{M}}$	800Hz - 970Hz @ 9Hz
30	$\overline{\mathcal{M}}$	800Hz - 970Hz @ 3Hz
31	— —	800Hz, 0.25s ON/1s OFF
32		500Hz - 1200Hz, 3.75s/0.25s OFF (AS2220)

* Note: Approved to EN 54-3 only!



1.2 Installation Instructions

Attention: Turn power off the loop circuit before installing the mounted sounder!

- 1. Choose the proper place for installation of the device.
- 2. Set the module address using programmer or directly from addressable fire panel.
- 3. Mount the fire base on the ceiling or on the wall of the protected premises using fixings according the mounting surface.
- 4. Connect the base to the fire panel using the wiring diagram.
- 5. Insert the device into the base and rotate clockwise until it drops into place the short mark on the base fits with that on the sounder body. Continue to rotate the sounder until its mark coincides with the long mark on the base a click is heard.
- 6. Program the device parameters.
- 7. Test the sounder for proper operation.

