

MCO Sense Multi Logic Control Unit

Instruction Sheet R10010GB0



Schneider Electric Fire & Security Oy

Sokerilinnantie 11 C FI-02600 Espoo, Finland Tel: +358 10 446 511

Website: www.schneider-electric.com Document number: R10010GB0

Published: 18.03.2019

© 2018 – Schneider Electric. All Rights Reserved. This information is only to be used as guidance. Subject to changes and errors.



Contents

MCC	O Sense Multi Logic Control Unit	4
1.1	Mechanical installation	
1.2	Product Codes	5
1.3	Electrical connections	5
1.4	Settings and LED indications	6
1.5	Configuration	
1.6	Configuration memory erasure	9
1.7	Software update	9
1.8	Electrical connections of OC-100L and OC-100R	10
1.9	Electrical connections RB-20	10
1.10	System principle	11




1 MCO Sense Multi Logic Control Unit

The MCO Sense Multi Logic Control Unit controls functions in the Esmi Fire Detection System. The MCO communicates with the FDP panel via the INFO serial communication line.

The logical functions of the MCO are configured with the MCO configuration tool. The MCO unit can control addressable outputs, control panel outputs and OC100R and OC100L outputs. MCO is compatible with Esmi Sense FDP and FX 3NET system.

1.1 Mechanical installation

MCO Sense Multi Logic Control Unit Mechanical installation

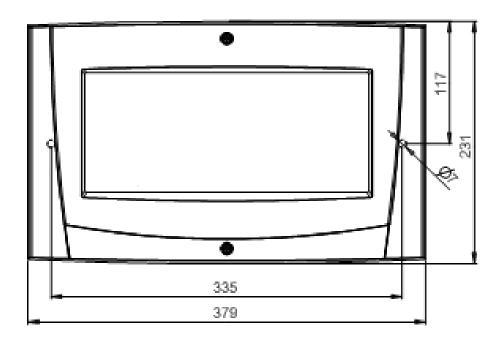




1.2 Product Codes

Product	Code	Description
МСО	FFS00703854	Panel version, wall mounting
MCOX-OB	FFS00703835	PCB version. Card slot mounting
OC-100L	FFS00703843	Open collector output for 100 LEDs
OC-100R	FFS00703844	Open collector output for 100 relays
COL-10	FFS00703846	10 LED cable
CCLO	FFS00703845	Connection cable for 10 LED output, 3m
RB20	FFS00703847	Relay board of 20 relays

1.3 Electrical connections

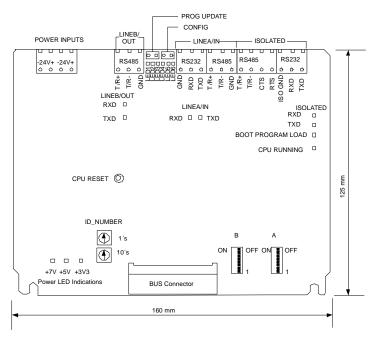

Note! Both 24V power inputs must be connected.



1.4 Settings and LED indications

A dip switch

MCO Sense Multi Logic Control Unit settings and LED indications

A1	OFF	NA		
Α.	ON	NA		
A2	OFF	NA		
	ON	NA		
А3	OFF	FDP-panel connection		
Α3	ON	ESA/MESA panel connection (message set F or older)		
A4	OFF	Not in use		
	ON			
A5	OFF	Not in use		
	ON			
A6	OFF	Not in use		
	ON			
A7	OFF	Not in use		
	ON	1		
A8	OFF	Normal state		
Αυ	ON	Acknowledge to erase configuration memory		



B dip switch

B1	OFF	"EXT" isolated line faults monitored	
	ON	"EXT" isolated line faults not monitored	
B2	OFF	"EXT" isolated line not in use	
	ON	"EXT" isolated line in use	
	OFF	OUT "B" port not in use	
В3	ON	OUT "B" port in use	
B4	OFF	"EXT" isolated port baud rate. See table below.	
	ON	"EXT" isolated port baud rate. See table below.	
B5	OFF	"EXT" isolated port baud rate. See table below.	
	ON	"EXT" isolated port baud rate. See table below.	
В6	OFF	IN "A" port baud rate 1200	
	ON	IN "A" port baud rate 9600	
B7	OFF	IN "B" port baud rate 1200	
	ON	IN "B" port baud rate 9600	
	OFF	To be "OFF"! Only for service purposes.	
B8	ON		

"EXT" isolated port baud rate

B4	B5	"EXT" port baud rate
OFF	OFF	1200
ON	OFF	2400
OFF	ON	4800
ON	ON	9600



LED indications in normal use

	Continuous	Faults in configuration file	
LED 1	Blinking (1s)	Configuration state	
LLD I	Blinking quickly (100	Waiting for the acknowledge of the erasure of	
	ms)	the configuration memory	
	Continuous	MCO logical error	
LED 2	Blinking(1s)	MCO logic ok	
	Blinking slowly(4s)	MCO installed but not configured	
	Continuous	Power supply input 1 or 2 fault	
LED 3	Blinking	NA	
LED 4	Continuous	IN "A" line fault	
LED 4	Blinking	IN "A" HW fault	
1 ED 5	Continuous	OUT "B" line fault	
LED 5	Blinking	OUT "B" HW fault	
	Continuous	"EXT" isolated line fault	
LED 6	Blinking	"EXT" isolated HW fault	

Note! In system fault all LED indications are continuous.

LED indications in start up condition (10 seconds)

LED 1	Continuous	Display HW installed	
LLD	OFF	Display HW not installed	
LED 2	Continuous	Isolated port installed	
	OFF	Isolated port not installed	
LED 3	Continuous	NA	
	OFF	NA	
LED 4	Continuous	LED board connector installed	
	OFF	LED board connector not installed	
LED 5	Continuous	NA	
	OFF	NA	
LED 6	Continuous	MCO HW installed	
	OFF	MCO HW not installed	



Jumpers for service purposes

Jumper	ON	OFF
Program update	Program update	Normal use
Configuration	Configuration state	Normal use

1.5 Configuration

The configuration is done with MCO configuration tool via incoming RS232 serial port. During the configuration of the MCO unit the communication line to the FDP panel (RS485) must be disconnected.

INFO protocol must be configured / enabled on the used port on fire panel (RS485 or RS232).

1.6 Configuration memory erasure

The configuration memory can be erased back to the factory defaults by the following:


- disconnect power from the unit (power inputs PI1 and PI2)
- set "config" jumper ON
- turn panel ID number switches to E and F (E = 10's, F=1's)
- connect power back
- follow the LED number 1:
- when the LED is blinking quickly turn dip switch A8 ON
- LED1 OFF: erasure in progress
- LED ON continuous: erasure is ready
- disconnect power, set ID switches back to "0" and remove the "config" jumper
- connect power back
- unit is starting without configuration data

1.7 Software update


The unit is set to software update state by setting "prog update" jumper ON and restarting the panel (by pressing the CPU reset button). The software update is done with PC loader software via incoming RS232 serial port. During the software update of the MCO unit communication line to the FDP panel (RS485) must be disconnected.



1.8 Electrical connections of OC-100L and OC-100R

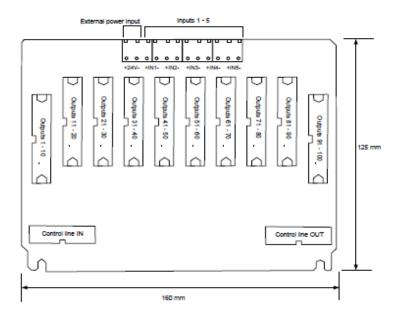

1.9 Electrical connections RB-20

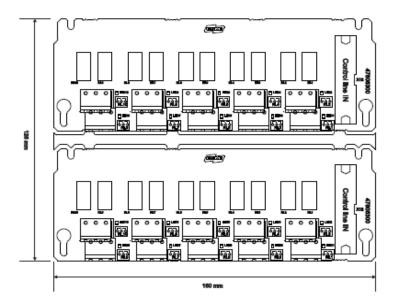



1.10 System principle

Note!

Only one MCO unit can be connected to the FDP Fire Detection system. The maximum number of MCO, MCOX-OB, FMP, DAP, REP, REPX-OB, ZLPX and ZLPX-IC units connected to one FDP panel is 16.

The RS232 setting is used for the configuration and software update.

The RS232 and RS485 on IN port may not be connected at the same time.

The INFO-line in the MCO (MCOX-OB) unit must be disconnected during the MCO (MCOX-OB) configuration.

Note! The maximum RS485 cable length between 2 devices is 1000 m.

The maximum RS232 cable length is 10 m.

The dimensioning of power supply cables must be calculated separately. An extra power supply unit must be used as needed.

