

# DIRIS Digiware S

Current measurement module with built-in sensors

for 3 circuits

**new**



Configuration  
with Easy Config System.



diris-dw\_127.psd

DIRIS Digiware S

## The solution for

- > Data centre
- > Healthcare

## Strong points

- > Plug & Play
- > Multi-circuit
- > Compact
- > Accurate
- > MID certified and more



RJ45 (Digiware Bus) cables  
are available.

## Integrated technologies



PreciSense



AutoCorrect



VirtualMonitor

For more information see our website  
[www.socomec.com](http://www.socomec.com)

## Conformity to standards

- > IEC 61557-12



- > UL 61010  
Guide FTRZ/PICQ  
File E257746



- > ANSI C12.20

- > EN 50470-1




- > EN 50470-3

- > Directive  
2014/32/EU



## Also available

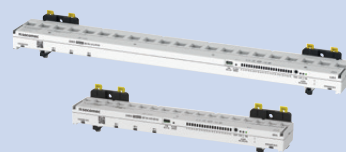

DIRIS Digiware BCM

In 18 or 21 circuits versions for  
the power distribution units (PDU)  
monitoring.

## Function

DIRIS Digiware S current acquisition modules have 3 integrated current sensors for the measurement of electrical circuits up to 63 A.

Positioned directly above or below the protective devices, they are associated with the DIRIS Digiware U voltage measurement module to measure consumption, and to monitor the electrical installation and the quality of the power supply.

## Advantages

### Plug & Play

- Save wiring time: the current sensors are integrated in the module.
- Quick RJ45 connection between modules.
- Positioning possible upstream or downstream of the protective device.

### Multi-circuit

Multiple DIRIS Digiware S modules can be used within the measurement system enabling the monitoring of a large number of loads.

### Compact

- A measurement module offering the best compactness/performance ratio of the market.
- Matches the pitch of the protective device.

### Accurate

DIRIS Digiware S modules offer class 0.5 accuracy (IEC 61557-12) and class C (EN 50470), allowing accurate measurements over a wide current range.

### MID certified and more

DIRIS Digiware S-130MID and S-135MID current modules comply with the MID Directive and guarantee accurate and reliable metering.

“Module B+D” certification means that an outside laboratory has certified the design of the meter and its production process.


They are also fitted with innovative functions that go beyond the standard offerings on the market:

- Innovative tamper-resistance systems: the MID modules have a smart alarm system that is more effective than the standard mechanical seals offered by MID meters.
- Integrated PreciSense Technology: MID modules have a class C energy accuracy measurement, which is the most accurate class under the MID directive. In addition, as with any DIRIS Digiware system, PreciSense technology offers the best accuracy on the market across the chain.





## General characteristics

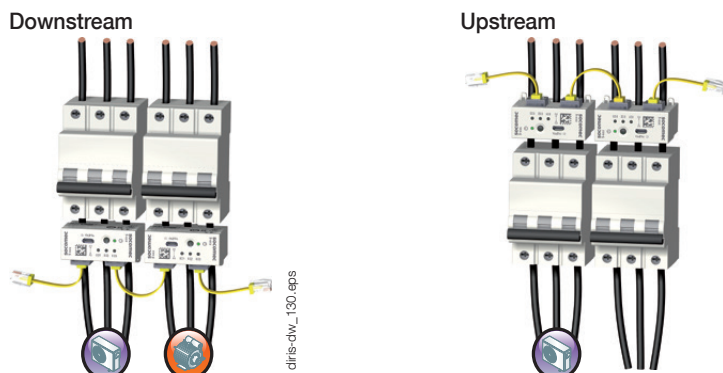- 3 integrated current sensors
- Measurement up to 63 A
- Configurable as 3 single-phase circuits or 1 three-phase circuit

### Functional diagram



The DIRIS Digiware S measurement module can be mounted upstream or downstream of the protective device solving issues of space constraints.

Application	Current measurement module with integrated sensors			
	Metering		Analysis	
				
<b>DIRIS Digiware S</b>	<b>S-130</b>	<b>S-130MID</b>	<b>S-135</b>	<b>S-135MID</b>
Number of current inputs	3	3	3	3
Basic current $I_b$	10 A	10 A	10 A	10 A
Maximum current $I_{max}$	63 A	63 A	63 A	63 A
Load type accepted	1P + N 2P / 2P + N 3P / 3P + N	1P + N 2P / 2P + N 3P / 3P + N	1P + N 2P / 2P + N 3P / 3P + N	1P + N 2P / 2P + N 3P / 3P + N
<b>Metering</b>				
± kWh, ± kvarh, kVAh	•	•	•	•
Multi-tariff (max 8)			•	•
Load curves			•	•
MID		•		•
<b>Multimesure</b>				
$I_1, I_2, I_3, I_n, \Sigma P, \Sigma Q, \Sigma S, \Sigma PF$	•	•	•	•
P, Q, S, PF per phase			•	•
Predictive power			•	•
Current unbalance ( $I_{nba}, I_{nb}, I_{dir}, I_{inv}, I_{hom}$ )			•	•
Phi, cos Phi, tan Phi			•	•
<b>Quality</b>				
THDi1, THDi2, THDi3, THDin			•	•
Individual harmonics I (up to 63rd)			•	•
Crest factors U, V, I			•	•
K factor			•	•
Overcurrents			•	•
<b>Alarms</b>				
Thresholds and combinations			•	•
Wiring errors			•	•
Protective device	•	•	•	•
<b>Trends</b>				
Average values			•	•
<b>Format</b>				
Width	54 mm	54 mm	54 mm	54 mm

To be compliant with the MID directive, the DIRIS Digiware system must be equipped with a D-50/D-70 display.

# DIRIS Digiware S


Current measurement module with built-in sensors  
for 3 circuits

## Mounting accessories

Temporary MCB insert  
(for use during panel assembly)





DIN rail and back plate mounting



Cable tie tether




## Dimensions (mm)

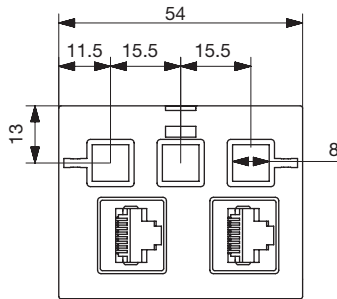

## Connections


Current is measured by the integrated inputs I01, I02 and I03 on the DIRIS Digiware S module.

3P+N - 3CT

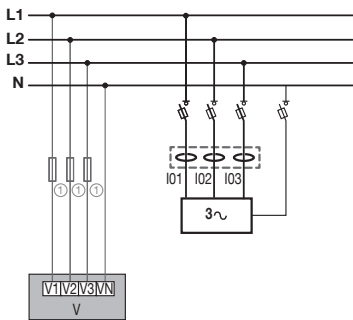


diris-dw\_118\_a\_x\_cat.ai

3P - 3CT

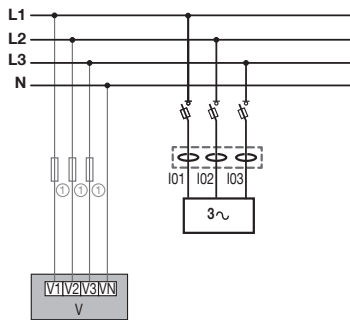


diris-dw\_119\_a\_x\_cat.ai

2P+N - 2CT & 2P+N - 1CT

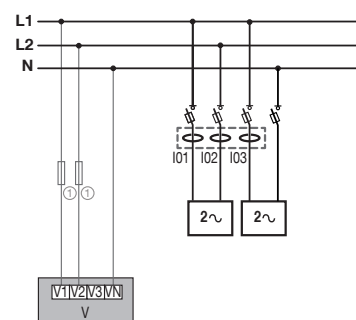


diris-dw\_120\_a\_x\_cat.ai

1P+N - 1 CT (3x)

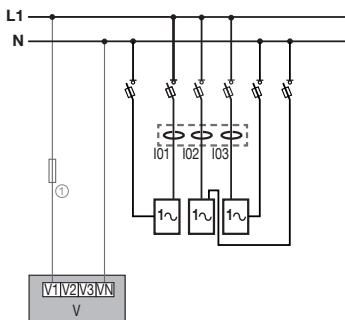


diris-dw\_121\_a\_x\_cat.ai

3P+N - 1CT (3x)

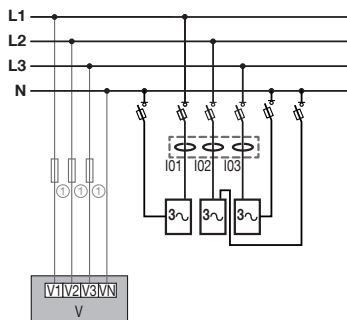

diris-dw\_122\_b\_x\_cat.ai

2P+N - 1CT (3x)

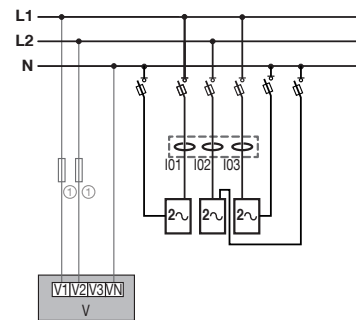

diris-dw\_123\_b\_x\_cat.ai



Fuses : 0.5 A gG/BS 88 2 A gG/0.5 A class CC

## Technical characteristics

### Measurement characteristics

Measurement of current	
Number of current inputs	3
Associated current sensors	Integrated in the product
Basic current I <sub>b</sub>	10 A
Maximum current I <sub>max</sub>	63 A
Current measurement accuracy	Class 0.5 IEC 61557-12
Measurement of energy	
Accuracy of active energy	Class 0.5 (IEC 61557-12) / Class C (EN 50470)
Accuracy of reactive energy	Class 1 IEC 61557-12

### Mechanical characteristics

Casing type	DIN rail or back plate mounting
Casing protection index	IP20/IK08
Weight	63 g
Module power consumption	0.35 VA

### Communication specifications

BUS Digiware	
Function	Connection between DIRIS Digiware S, U, I modules and system interfaces
Cable type	Specific Socomec cable with RJ45 connections
USB	
Protocol	MODBUS RTU on USB
Function	Configuration of DIRIS Digiware modules
Location	On each DIRIS Digiware module
Connection	Type B micro USB connector

### Caractéristiques environnementales

Ambient operating temperature	-10 ... +55 °C
Storage temperature	-25 ... +70 °C
Operating humidity	40 °C/95 % HR
Operating altitude	< 2000 m

## Références

DIRIS Digiware S		Référence
S-130	Metering - 3 integrated current inputs	4829 0160
S-130MID	Metering - 3 integrated current inputs + MID	4829 0163
S-135	Analysis - 3 integrated current inputs	4829 0161
S-135MID	Analysis - 3 integrated current inputs + MID	4829 0164
Accessories		Référence
DIN rail and back plate mounting clip (x10)		4829 0195
Temporary MCB insert (x10)		4829 0196

To be compliant with the MID directive, the DIRIS Digiware system must be equipped with a D-50/D-70 display.

Digiware connection cables		Référence
RJ45 cables for Digiware Bus	Length 0.06 m <sup>(1)</sup>	4829 0189
	Length 0.10 m	4829 0181
	Length 0.20 m	4829 0188
	Length 0.50 m	4829 0182
	Length 1 m	4829 0183
	Length 2 m	4829 0184
	Length 3 m	4829 0190
	Length 5 m	4829 0186
	Length 10 m	4829 0187
	50 m reel + 100 connectors	4829 0185
Termination for Digiware Bus (supplied with interfaces C and D)		4829 0180
USB configuration cable		4829 0050

(1) The RJ45 6 cm cables can be used on 3-pole or 4-pole protective devices.

## Expert services



To continuously guarantee a functional and accurate energy monitoring system, Socomec offers a wide range of services:

- Incorporation of devices.
- System audit.
- Commissioning.
- Training for your teams.

Also, Ideal for ISO 50001 sites (periodic verification):

- Measurement consistency check to 3%.
- Measurement accuracy check to 0.2%.

For more information, please call your Socomec contact